


IF DOOR IS TO BE CONCEALED BY SECONDARY WALL ALLOW MINIMUM CAVITY OF 160mm

| TRACK SIZE | HEADROOM |
|------------|----------|
| 301 | 290 |
| 305 | 330 |
| 307 | 360 |

REFER TO FYRESAFE SLIDING FIRE DOOR BROCHURE FOR TRACK SELECTION

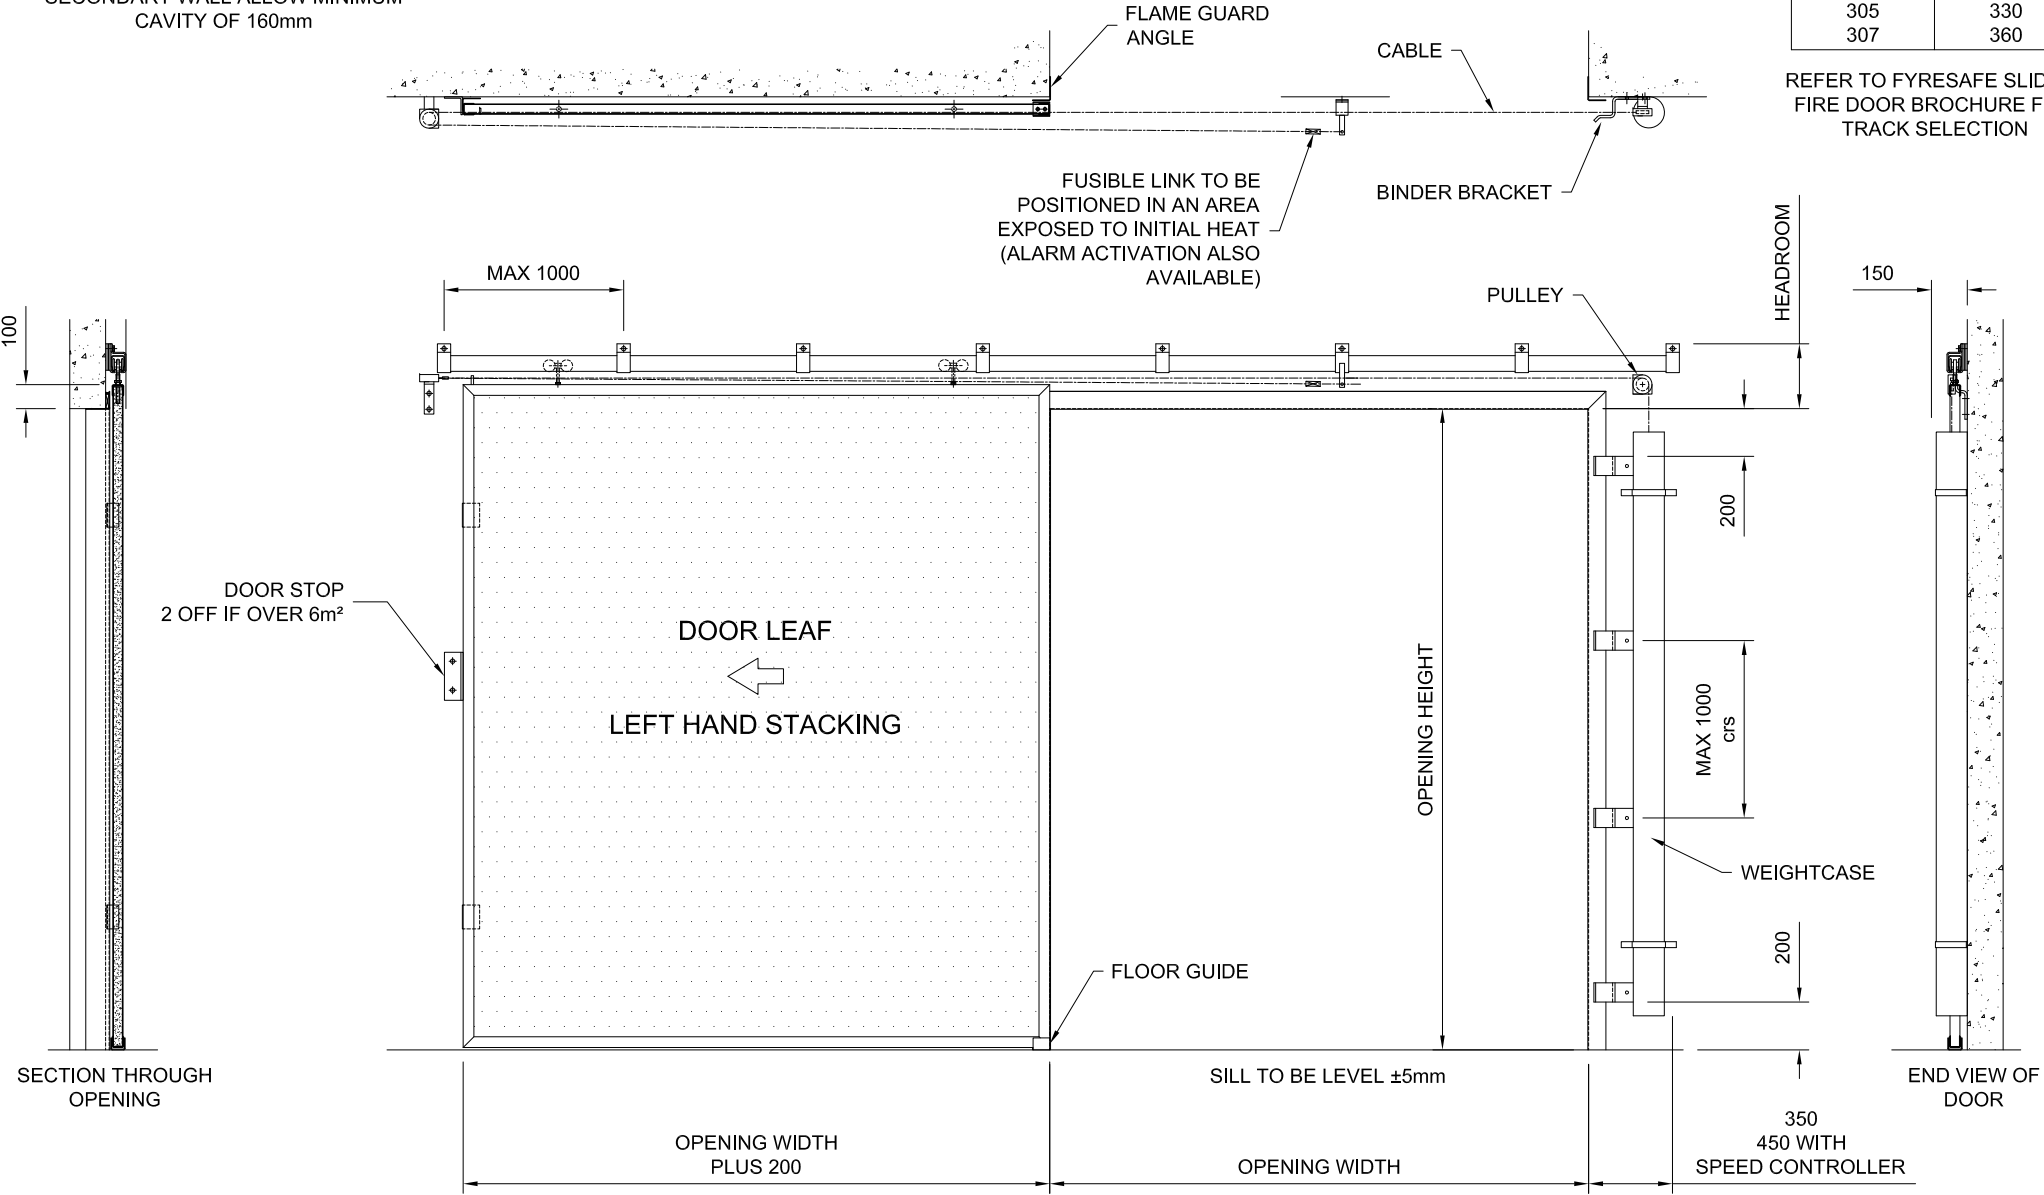

SPEED CONTROLLERS REQUIRED ON:
DOORS OVER 6m WIDE
OR
ALARM ACTIVATED DOORS OVER 9m²

We reserve the right to alter specification without notice and without incurring obligation

FYRESAFE SLIDING FIRE DOOR – OPTION 2
FREQUENT USE – FUSIBLE LINK RELEASE



| MATERIAL - FINISH | | | CODE No. | SCALE | DRG No. | ISS. |
|-------------------|----------|----|----------|--------|---------|----------|
| B | 03.07.13 | TS | | | | |
| ISS. | DATE | BY | | DRAWN | TS | 12.06.13 |
| | | | | APPVD. | | |

FYRESAFE_Op2 B